

ANSI/BICSI N3-20

Planning and Installation Methods for the Bonding and Grounding of Telecommunication and ICT Systems and Infrastructure

**DEMONSTRATION VERSION
NOT FOR RESALE**

Committee Approval: December 3, 2019

ANSI Final Action: December 17, 2019

First Published: January 7, 2020



BICSI International Standards

BICSI international standards contain information deemed to be of technical value to the industry and are published at the request of the originating committee. The BICSI International Standards Program subjects all of its draft standards to a rigorous public review and comment resolution process, which is a part of the full development and approval process for any BICSI international standard.

The BICSI International Standards Program reviews its standards at regular intervals. By the end of the fifth year after a standard's publication, the standard will be reaffirmed, rescinded, or revised according to the submitted updates and comments from all interested parties.

Suggestions for revision should be directed to the BICSI International Standards Program, care of BICSI.

Copyright

This BICSI document is a standard and is copyright protected. Except as permitted under the applicable laws of the user's country, neither this BICSI standard nor any extract from it may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, photocopying, recording, or otherwise, without prior written permission from BICSI being secured.

Requests for permission to reproduce this document should be addressed to BICSI.

Reproduction may be subject to royalty payments or a licensing agreement.

Violators may be prosecuted.

Published by:



BICSI
8610 Hidden River Parkway
Tampa, FL 33637-1000 USA

Copyright © 2020 BICSI
All rights reserved
Printed in U.S.A.

Notice of Disclaimer and Limitation of Liability

BICSI standards and publications are designed to serve the public interest by offering information communication and technology systems design guidelines and best practices. Existence of such standards and publications shall not in any respect preclude any member or nonmember of BICSI from manufacturing or selling products not conforming to such standards and publications, nor shall the existence of such standards and publications preclude their voluntary use, whether the standard is to be used either domestically or internationally.

By publication of this standard, BICSI takes no position respecting the validity of any patent rights or copyrights asserted in connection with any item mentioned in this standard. Additionally, BICSI does not assume any liability to any patent owner, nor does it assume any obligation whatever to parties adopting the standard or publication. Users of this standard are expressly advised that determination of any such patent rights or copyrights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard does not purport to address all safety issues or applicable regulatory requirements associated with its use. It is the responsibility of the user of this standard to review any existing codes and other regulations recognized by the national, regional, local, and other recognized authorities having jurisdiction (AHJ) in conjunction with the use of this standard. Where differences occur, those items listed within the codes or regulations of the AHJ supersede any requirement or recommendation of this standard.

All warranties, express or implied, are disclaimed, including without limitation, any and all warranties concerning the accuracy of the contents, its fitness or appropriateness for a particular purpose or use, its merchantability and its non-infringement of any third party's intellectual property rights. BICSI expressly disclaims any and all responsibilities for the accuracy of the contents and makes no representations or warranties regarding the content's compliance with any applicable statute, rule, or regulation.

BICSI shall not be liable for any and all damages, direct or indirect, arising from or relating to any use of the contents contained herein, including without limitation any and all indirect, special, incidental, or consequential damages (including damages for loss of business, loss of profits, litigation, or the like), whether based upon breach of contract, breach of warranty, tort (including negligence), product liability or otherwise, even if advised of the possibility of such damages. The foregoing negation of damages is a fundamental element of the use of the contents hereof, and these contents would not be published by BICSI without such limitations.

TABLE OF CONTENTS

	PREFACE	ix
1	Introduction	1
1.1	General	1
1.2	Purpose	1
1.3	Categories of Criteria	1
2	Scope	3
3	Required Standards and Documents	5
4	Definitions, Acronyms, Abbreviations, and Units of Measurement	7
4.1	Definitions	7
4.2	Acronyms and Abbreviations	8
4.3	Units of Measurement	8
4.4	Standardized and Regional Terminology Equivalents	9
5	Regulatory and Safety	11
5.1	Requirements	11
5.2	Recommendations	11
6	Components	13
6.1	General	13
6.2	Conductors	13
6.3	Busbars	13
6.3.1	Primary Bonding Busbar (PBB)	13
6.3.2	Secondary Bonding Busbar (SBB)	13
6.4	Bonding Connectors	14
6.4.1	Compression	14
6.4.2	Mechanical	14
6.4.3	Exothermic	14
7	Planning	15
7.1	General	15
7.2	Electrical System	15
7.2.1	Bonding to the Electrical Power System	15
7.2.2	Primary Protector	15
7.3	Bonding Conductors	15
7.3.1	General	15
7.3.2	Size	15
7.3.3	Usage	15
7.4	Busbars	16
7.4.1	Primary Bonding Busbar (PBB)	16
7.4.2	Secondary Bonding Busbar (SBB)	16
7.5	Bonding Connections	16

7.6	Connections to the PBB/SBB	16
7.6.1	Electrical Distribution Panel (EDP).....	16
7.6.2	Structural Metal.....	16
7.6.3	Conduit.....	16
7.6.4	Telecommunications Equipment Bonding Conductor (TEBC).....	16
7.7	Bonding Equipment, Racks and Cabinets	17
7.7.1	General.....	17
7.7.2	Methods to Bond Equipment Racks to the Bonding System.....	17
7.7.3	Rack Isolation.....	19
8	Installation Practices	21
8.1	Electrical Systems	21
8.1.1	Bonding to the Electrical Power System.....	21
8.1.2	Primary Protector.....	21
8.2	Bonding Conductors	21
8.3	Bonding Connections	22
8.4	Primary Bonding Busbar / Secondary Bonding Busbar (PBB/SBB)	22
8.4.1	Installation of the PBB/SBB.....	22
8.4.2	Connections Between a PBB/SBB and an EDP.....	22
8.5	Bonding the TBC, BBC, TEBC, UBC, or RBC to the PBB or the SBB	22
8.5.1	General.....	22
8.5.2	Installation.....	23
8.6	Routing the TEBC from the PBB/SBB to the Rack/Cabinet	27
8.6.1	General.....	27
8.6.2	Bends.....	28
8.6.3	Separation.....	28
8.7	Bonding Equipment Cabinets and Racks	28
8.7.1	TEBC Method.....	28
8.7.2	Supplemental Bonding Structure Method.....	29
8.7.3	Structural Bonding of Equipment Cabinets/Equipment Racks.....	30
8.8	Bonding Equipment to the Rack Bonding Conductor or Rack Bonding Busbars	31
8.9	Bonding Cable Runways and Cable Trays	31
8.9.1	General.....	31
8.9.2	Installation.....	33
8.10	Ancillary Bonding	33
9	Testing and Inspection	35
9.1	Two-Point Ground/Continuity Testing	35
9.2	Inspection	35
Appendix A	Related Documents (Informative)	37

INDEX OF FIGURES

Section 2	Scope	
Figure 2-1	Example Illustration of a Telecommunications Bonding and Grounding System	3
Figure 6-1	Example of a PBB.....	13
Figure 6-2	Example of an SBB.....	13
Figure 6-3	Examples of Compression Connectors.....	14
Figure 6-4	Example of a Mechanical Connector	14
Figure 6-5	Example of an Exothermic Weld	14
Figure 7-1	Example of Three Methods to Bond Equipment and Racks	18
Figure 7-2	Example of Rack Isolation Using a Rack Isolation Pad.....	19
Figure 8-1	Example of an Exothermic Connection and a Two-Hole Lug Connection to a Busbar	22
Figure 8-2	Example of a Two-Hole Lug.....	22
Figure 8-3	Example of Trimmed Insulation from a Conductor	23
Figure 8-4	Example of a Conductor Seen Through the Inspection Port	23
Figure 8-5	Example of Crimping a Conductor in the Barrel of the Lug	23
Figure 8-6	Example of a Barrel with Three Crimps Applied.....	23
Figure 8-7	Example of a Mold for an Exothermic Weld	24
Figure 8-8	Mold Being Locked and Disk Inserted.....	24
Figure 8-9	Pouring Weld Metal into a Mold.....	24
Figure 8-10	Igniting the Accelerant.....	24
Figure 8-11	Removing Oxidation from a Busbar	25
Figure 8-12	Applying an Antioxidant to the Cleaned Area of a Busbar	25
Figure 8-13	Attaching a Lug to a Busbar.....	25
Figure 8-14	Lug Mounting Configuration	26
Figure 8-15	Illustration of the Use of a Belleville Washer	26
Figure 8-16	Example of a TEBC to Rack Bonding Conductor Connection	27
Figure 8-17	Example of a TEBC Routed on a Cable Tray	27
Figure 8-18	Illustrated Bend Radius of a TEBC.....	28
Figure 8-19	Illustration of a Connection Point to a Rack from a TEBC.....	29
Figure 8-20	Example of Equipment Rack Bonding to a Mesh-BN	29
Figure 8-21	Example of Detachable Bond Connections to a Cabinet Side Panel and Door	30
Figure 8-22	Illustration of Acceptable and Unacceptable Equipment Bonding.....	31
Figure 8-23	Examples of Two-Hole Lugs and a Wire Connector	32
Figure 8-24	Example of a Bonding Jumper and its Installation Between Cable Tray Segments.....	32
Figure 8-25	Examples of a Flange Type Bonding Connector and Exothermic Weld Connection.....	33
Figure 9-1	Example of an Earth Ground Resistance Tester.....	35

This page intentionally left blank

INDEX OF TABLES

Section 4	Definitions, Acronyms, Abbreviations, and Units of Measurement	
Table 4-1	Regional Terminology Equivalents – by Standardized Term.....	9
Table 4-2	Regional Terminology Equivalents – by Regional Term.....	10

This page intentionally left blank

PREFACE

Revision History

January 7, 2020 First publication of this standard, titled ANSI/BICSI N3-20, *Planning and Installation Methods for the Bonding and Grounding of Telecommunication and ICT Systems and Infrastructures*

Translation Notice

This standard may have one or more translations available as a reference for the convenience of its readers. As that act of translation may contain inconsistencies with the original text, if differences between the translation and the published English version exist, the English text shall be used as the official and authoritative version.

Acknowledgments

BICSI gratefully acknowledges the contribution of figures by nVent Electric, Harger Lightning and Grounding, and Fluke Networks.

This page intentionally left blank

1 Introduction

1.1 General

Personnel safety and protection of susceptible electronic equipment from ground faults, lightning, ground potential rise, and electrical surges is of the utmost importance at telecommunications facilities. Cloud to ground lightning discharges must find a path to ground; either discharging directly to the ground itself or to structures in contact with ground. Electrical transients must return to their source, many times following similar ground paths. In either event, proper bonding and grounding reduces the harmful effects associated with these electrical events.

Metallic components for power distribution systems are bonded together to provide an effective ground fault current path to allow proper operation of overcurrent devices. For telecommunications systems, metallic components are bonded to provide a low impedance path for electrical surges and transient voltages to return to their power source. The earth is also involved as a path for grounded (earthed) power systems and for lightning events. Lightning, fault currents, circuit switching (motors starting and stopping), and electrostatic discharge (ESD) are common causes of surges and transient voltages. An effective bonding and grounding system helps to minimize the damaging effects of electrical surges.

Proper bonding and grounding of electrical and information communication technology (ICT) systems infrastructure facilitates their intended operation. Improperly bonded and grounded electrical systems are a primary cause of power quality issues, which may affect information technology systems operation.

Other performance items related to bonding and grounding for telecommunications within a building involve power systems, surge protective devices, and electromagnetic compatibility (EMC). IEEE 1100 contains recommended practices on these and related subjects.

1.2 Purpose

The purpose of this standard is to allow the designer and installer to enhance their knowledge of effective telecommunications and ICT bonding and grounding systems and to strive for installations in a neat and workmanlike manner.

1.3 Categories of Criteria

Two categories of criteria are specified – mandatory and advisory.

- Mandatory criteria generally apply to protection, performance, administration, and compatibility; they specify the absolute minimum acceptable requirements.
- Advisory or desirable criteria are presented when their attainment will enhance the general performance of the component, system, or other element as indicated within all its contemplated applications.

Mandatory requirements are designated by the word *shall*; advisory recommendations are designated by the words *should*, *may*, or *desirable*, which are used interchangeably in this standard. While requirements and recommendations are typically separated to assist in usability, paragraphs or sections may exist where both appear together for context or readability.

Where equivalent local codes and standards exist, requirements from these local specifications shall apply. Where reference is made to a requirement that exceeds minimum code requirements, the specification requirement shall take precedence over any apparent conflict with applicable codes.

This page intentionally left blank

2 Scope

This standard specifies aspects of planning and installation of bonding and grounding systems for telecommunications and information communication technology (ICT) systems and infrastructure within a customer premises (see Figure 2-1). This standard is intended to enhance the planning, specification and layout of an effective telecommunications bonding and grounding system. Additionally, this standard specifies installation requirements for components of the telecommunications bonding and grounding system, and when performed correctly, will produce neat and workmanlike results.

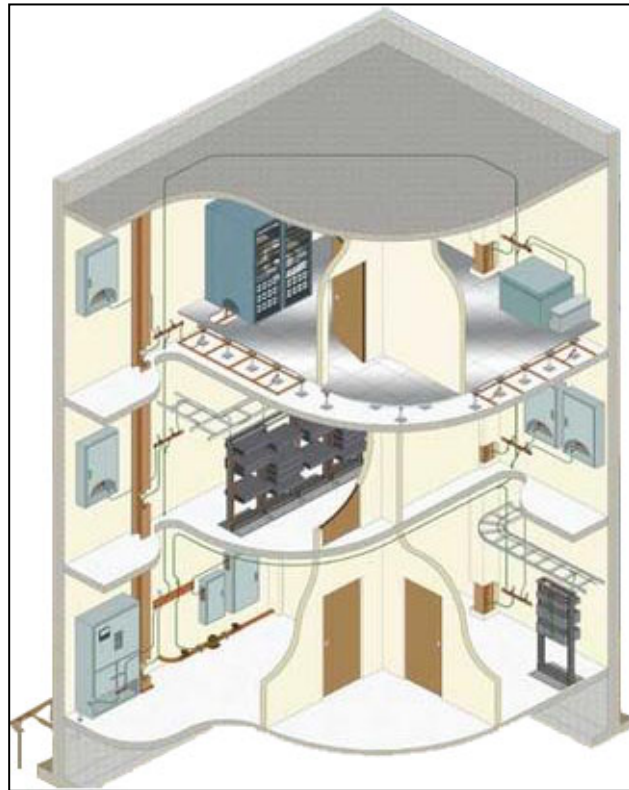


Figure 2-1
Example Illustration of a Telecommunications Bonding and Grounding System

This page intentionally left blank

3 Required Standards and Documents

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

Canadian Standards Association (CSA)

- C22.1, *Canadian Electrical Code, Part I, Safety Standard for Electrical Installations*
- Z462, *Workplace Electrical Safety*

European Committee for Electrotechnical Standardization (CENELEC)

- EN 50310, *Telecommunications bonding networks for buildings and other structures*

International Organization for Standardization (ISO)

- ISO/IEC 30129, *Information technology – Telecommunications bonding networks for buildings and other structures*

Institution of Engineering and Technology (IET)

- *Requirements for Electrical Installations (BS 7671)*

National Fire Protection Association (NFPA)

- NFPA 70[®], *National Electrical Code[®] (NEC[®])*
- NFPA 70E[®], *Standard for Electrical Safety in the Workplace*

Standards Australia

- AS/NZS 3000, *Electrical installations “Wiring Rules”*

Telecommunication Industry Association (TIA)

- ANSI/TIA-607, *Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises*

This page intentionally left blank

4 Definitions, Acronyms, Abbreviations, and Units of Measurement

4.1 Definitions

For the purposes of this standard, the following terms and definitions apply. Some terms and definitions may also be represented by an acronym as listed in Section 4.2.

NOTE: The terms below may be known by one or more regional equivalents. See Section 4.4.

backbone bonding conductor	A telecommunication bonding connection which interconnects telecommunications bonding backbones.
bonded (bonding)	The joining of metal parts together to form an electrically conductive path to <i>ground</i> .
coupled bonding conductor	A separate conductor in contact with, routed with, and secured to a communications cable. It may also be a metallic shield enclosing all of the conductors in a communications cable.
ground	The earth.
grounded (grounding)	Connected (connecting) to ground or to a conductive body that extends the ground connection.
Listed	Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction (AHJ), that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states either that the equipment, material or services meets appropriate standards or has been tested and found suitable for use in a specified manner.
point of entrance	Within a building, the point at which the wire or cable emerges from an external wall, from a concrete floor slab, or from a rigid metal conduit or an intermediate metal conduit grounded to an electrode.
primary bonding busbar	A busbar placed in a convenient and accessible location and bonded, by means of the telecommunications bonding conductor, to the buildings service equipment (power) ground.
primary protector	The protector located at the building telecommunications entrance point.
rack bonding busbar	A busbar within a cabinet, frame or rack.
rack bonding conductor	Bonding conductor from the rack or rack bonding busbar to the telecommunications equipment bonding conductor.
secondary bonding busbar	A common point of connection for telecommunications system and equipment bonding to ground and located in the distributor room.
supplementary bonding structure	A set of conductors or conductive elements formed into a grid or provided as a conductive plate and becomes part of the bonding network to which it is intentionally attached.
telecommunications bonding backbone	A conductor that interconnects the primary bonding busbar to the secondary bonding busbar.
telecommunications bonding conductor	A conductor that interconnects the building's service or building's feeder equipment (power) ground to the telecommunications grounding system.
telecommunications equipment bonding conductor	A conductor that connects the primary bonding busbar, secondary bonding busbar or supplementary bonding network to equipment racks or cabinets, rack bonding busbars or rack bonding conductors.

unit bonding conductor A bonding conductor used to connect a rack/cabinet mounted equipment unit to the bonding busbar or conductor utilized in that rack or/cabinet.

4.2 Acronyms and Abbreviations

Abbreviations and acronyms, other than in common usage, are defined as follows:

ac	alternating current
AHJ	authority having jurisdiction
AWG	American wire gauge
BBC	backbone bonding conductor
CBC	coupled bonding conductor
CBN	common bonding network
EDP	electrical distribution panel
EMC	electromagnetic compatibility
ENT	electrical nonmetallic tubing
ESD	electrostatic discharge
ICT	information communication technology
Mesh-BN	mesh bonding network
PBB	primary bonding busbar
NRTL	nationally recognized testing laboratory
RBB	rack bonding busbar
RBC	rack bonding conductor
SBB	secondary bonding busbar
SRG	signal reference grid
SRPP	system reference potential plane
SRS	signal reference structure
TBB	telecommunications bonding backbone
TBC	telecommunications bonding conductor
TEBC	telecommunications equipment bonding conductor
UBC	unit bonding conductor

4.3 Units of Measurement

The units of measurement used in this standard are metric. Approximate conversions from metric to U.S. customary units are provided in parentheses. For example, 100 millimeters (4 inches).

Units of measurement used in this standard are defined below:

ft	foot
in	inch
m	meter
mm	millimeter

4.4 Standardized and Regional Terminology Equivalents

International efforts to standardized bonding terminology are ongoing and are documented within ISO/IEC 30129. While this standard utilizes the terminology in ISO/IEC 30129, Table 4-1 provides regional equivalent expressions per ISO/IEC terms and Table 4-2 provides regional terms with the ISO/IEC 30129 equivalent.

Table 4-1 Regional Terminology Equivalents – by Standardized Term

<i>Term Used in this Standard</i>	<i>Regional Equivalent Terms</i>
Backbone Bonding Conductor (BBC)	Grounding Equalizer (GE) Horizontal Equalizer
Primary Bonding Busbar (PBB)	Building Principal Ground (BPG) CO GRD Bus COG Facility Ground Main Earthing Terminal (MET) Master Ground Bar (MGB) OPGPB Principal Ground Point (PGP) Bus Reference Point 0 (RP0) Telecommunications Main Grounding Busbar (TMGB) Zero Potential Reference Point
Rack Bonding Busbar (RBB)	Rack Grounding Busbar
Secondary Bonding Busbar (SBB)	Approved Floor Ground Extended Reference Point 0 (Extended RP0) Floor Ground Bar (FGB) Telecommunications Grounding Busbar (TGB)
Telecommunications Bonding Backbone (TBB)	Equalizer Equalizing Conductor Vertical Equalizer Vertical Ground Riser
Telecommunications Bonding Conductor (TBC)	Bonding Conductor for Telecommunications (BCT)

Table 4-2 Regional Terminology Equivalents – by Regional Term

<i>Regional Term</i>	<i>Term Used in this Standard</i>
Approved Floor Ground	Secondary Bonding Busbar (SBB)
Bonding Conductor for Telecommunications (BCT)	Telecommunications Bonding Conductor (TBC)
Building Principal Ground (BPG)	Primary Bonding Busbar (PBB)
CO GRD Bus	Primary Bonding Busbar (PBB)
COG	Primary Bonding Busbar (PBB)
Equalizer	Telecommunications Bonding Backbone (TBB)
Equalizing Conductor	Telecommunications Bonding Backbone (TBB)
Extended Reference Point 0 (Extended RP0)	Secondary Bonding Busbar (SBB)
Facility Ground	Primary Bonding Busbar (PBB)
Floor Ground Bar (FGB)	Secondary Bonding Busbar (SBB)
Grounding Equalizer (GE)	Backbone Bonding Conductor (BBC)
Horizontal Equalizer	Backbone Bonding Conductor (BBC)
Main Earthing Terminal (MET)	Primary Bonding Busbar (PBB)
Master Ground Bar (MGB)	Primary Bonding Busbar (PBB)
OPGPB	Primary Bonding Busbar (PBB)
Principal Ground Point (PGP) Bus	Primary Bonding Busbar (PBB)
Rack Grounding Busbar	Rack Bonding Busbar (RBB)
Reference Point 0 (RP0)	Primary Bonding Busbar (PBB)
Telecommunications Grounding Busbar (TGB)	Secondary Bonding Busbar (SBB)
Telecommunications Main Grounding Busbar (TMGB)	Primary Bonding Busbar (PBB)
Vertical Equalizer	Telecommunications Bonding Backbone (TBB)
Vertical Ground Riser	Telecommunications Bonding Backbone (TBB)
Zero Potential Reference Point	Primary Bonding Busbar (PBB)

5 Regulatory and Safety

5.1 Requirements

Installers shall follow the applicable regulations, codes and AHJ requirements for the site.

NOTE: Examples of applicable site-specific codes include:

- NFPA 70®, *National Electrical Code*®
- C22.1, *Canadian Electrical Code, Part I, Safety Standard for Electrical Installations*
- BS 7671, *Requirements for Electrical Installations. IET Wiring Regulations*
- AS/NZS 3000, *Electrical installations (the Wiring Rules)*

While most of the code requirements for the job should be included in the scope of work documents, always review the local code requirements with the local authority having jurisdiction (AHJ) before proceeding with the installation. This includes reviewing what code and edition is adopted, and what, if any, exceptions to the code are adopted by the governing authority (i.e., AHJ).

If no code has been adopted locally, consult with fire or building AHJs to determine what agency is responsible for that geographic area and what codes are in effect. Do not depend on other installers, contractors, or even company personnel in making these determinations.

Installation practices shall comply with applicable safety regulations and requirements and regulations (e.g., Occupational Safety & Health Administration (OSHA), AS/NZS 3000).

5.2 Recommendations

Only qualified persons familiar with telecommunications cabling, electrical wiring, or both should perform the work described in this publication.

Some counties may have additional standards or guidelines (e.g., United States: NFPA 70E, Canada: CSA Z462) for the performance of electrical work. Where applicable standards or guidelines are not available or otherwise specified, it is recommended that all work be performed in accordance with NFPA 70E.

Installers should follow manufacturer's instructions, and contract documents when installing telecommunications cabling.